

**SCHMATIC SERVICE MAIN CONNECTION ARRANGEMENT FOR FRESH WATER MAIN
WITH STAINLESS STEEL PIPE (OPTION 1)**


C	CONNECTION USING STAINLESS STEEL PIPE ADDED (OPTION 1)	C.H. LEUNG	16/10/24
B	CONNECTION USING CORRUGATED STAINLESS STEEL TUBE ADDED	K.H. HO	15/4/21
A	GENERAL REVISION	C.M. LEE	12/2/09
REF.	REVISION	APPROVED	DATE

SCHMATIC SERVICE MAIN CONNECTION



**水務署
Water Supplies Department**

APPROVED	C.H. NG AD/NW	DRAWING NO.	CSWP
DATE	14/9/07	WSD 1.44C (SHEET 1 OF 4)	
SCALE	N.T.S.		

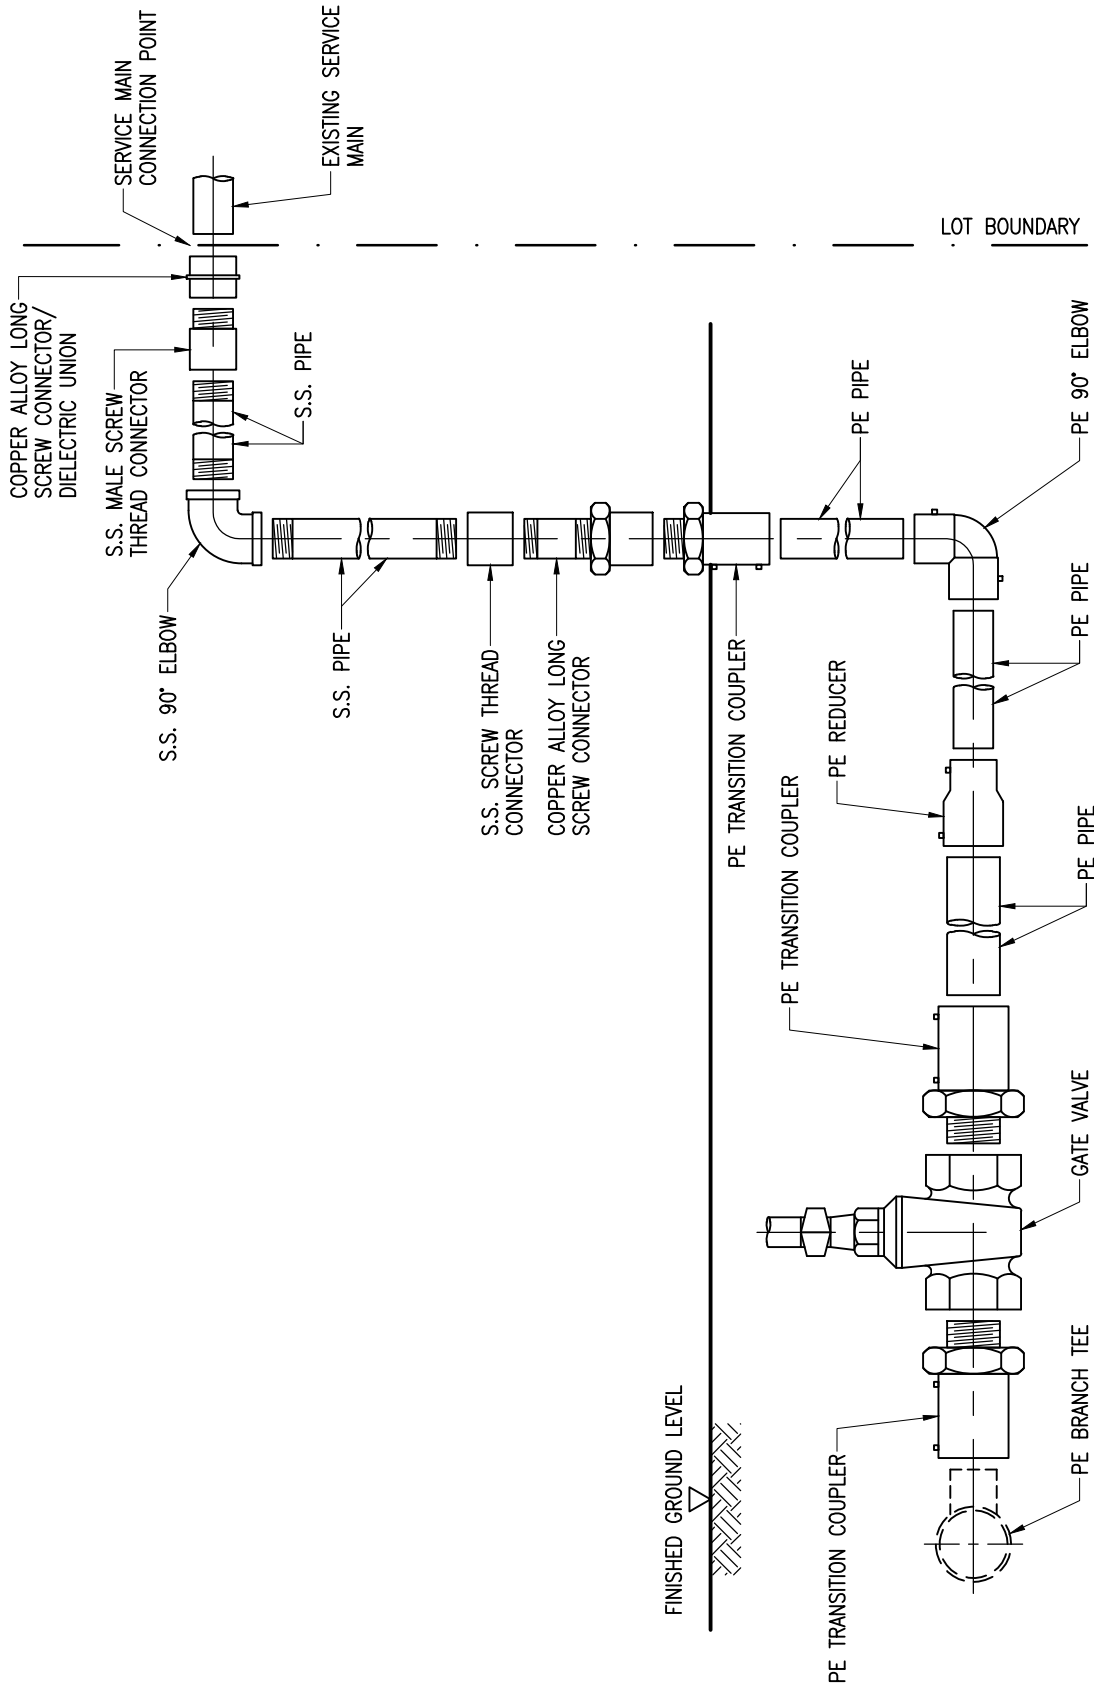

SCHEMATIC SERVICE MAIN CONNECTION ARRANGEMENT FOR FRESH WATER MAIN

WITH STAINLESS STEEL PIPE (OPTION 2)



水務署
Water Supplies Department

SCHEMATIC SERVICE MAIN CONNECTION

APPROVED

C.H. NG
AD/NW

DATE

14/9/07

SCALE

N.T.S.


DRAWING NO.

WSD 1.44C

(SHEET 2 OF 4)

CSWP

Cad Ref. : WSD014403-C.dwg

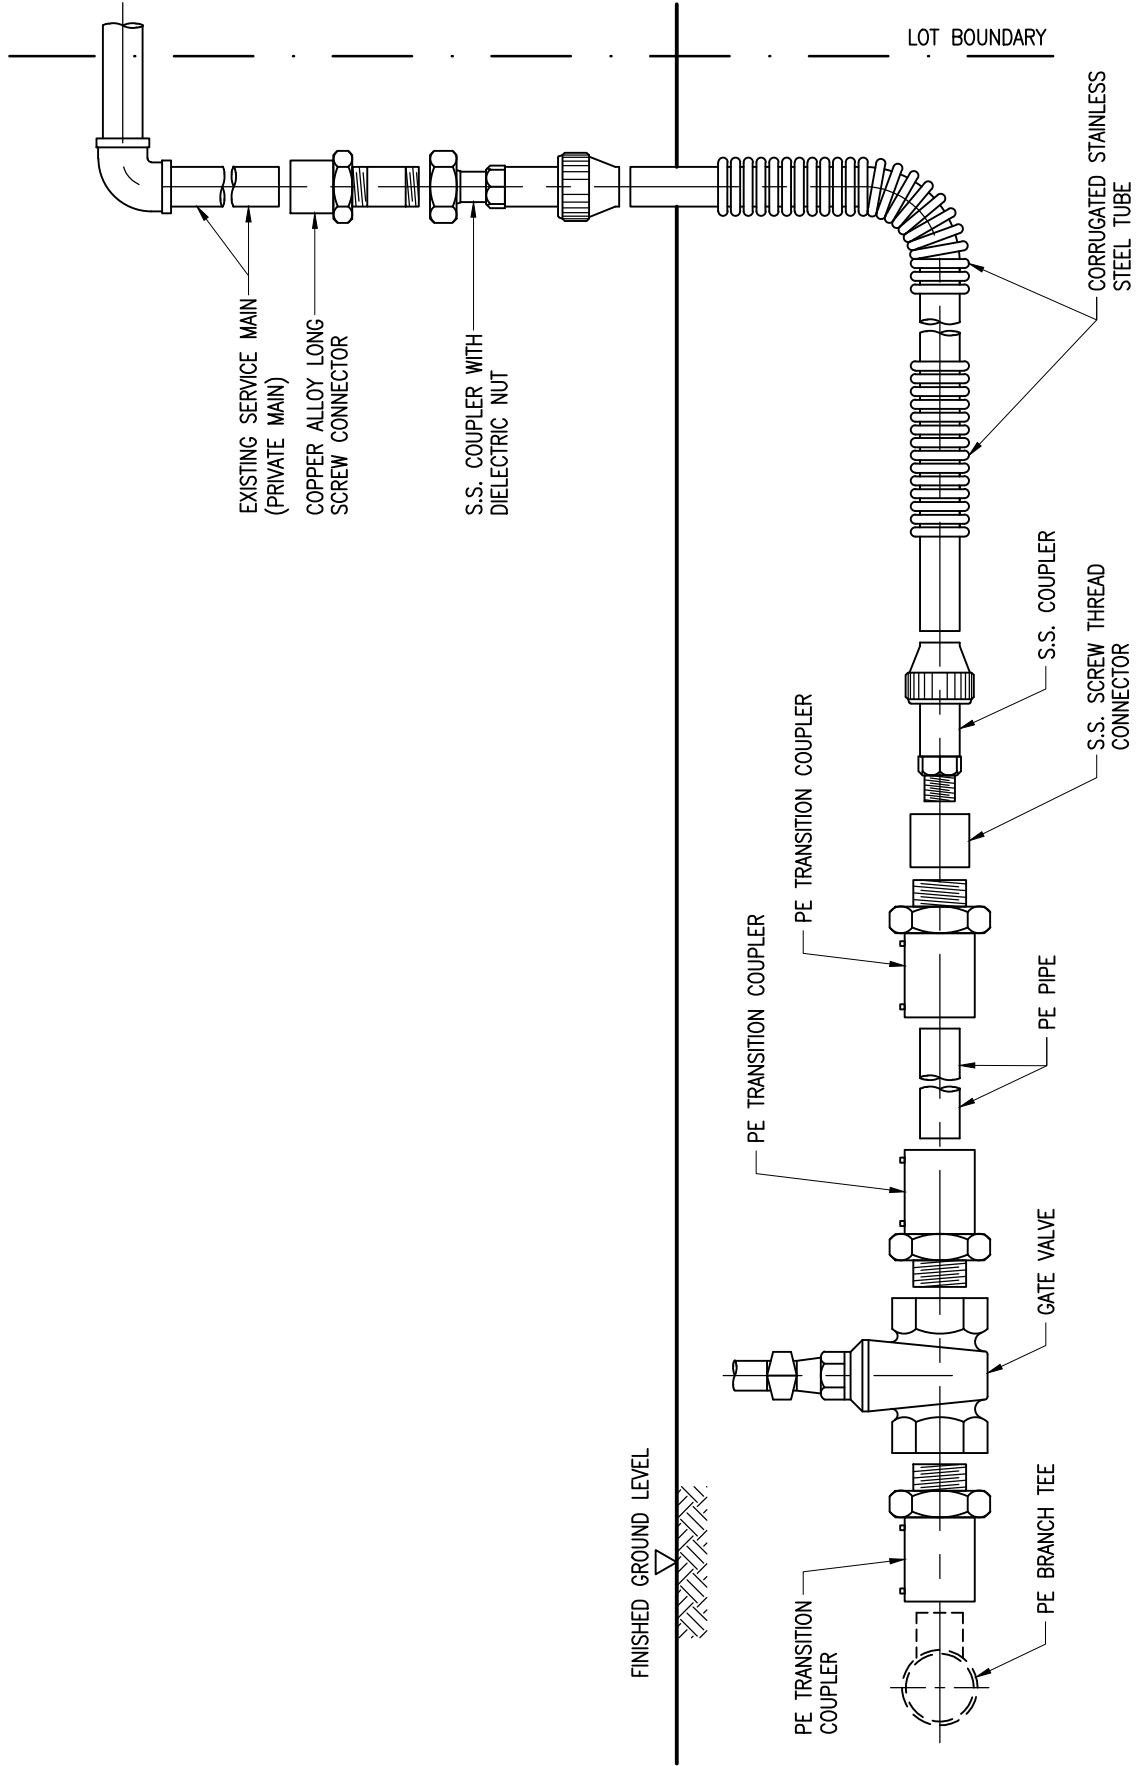

SCHEMATIC SERVICE MAIN CONNECTION ARRANGEMENT FOR FRESH WATER MAIN
WITH CORRUGATED STAINLESS STEEL TUBE

SCHEMATIC SERVICE MAIN CONNECTION



水務署
Water Supplies Department

APPROVED

C.H. NG
AD/NW

DATE

14/9/07


SCALE

N.T.S.

DRAWING NO.

WSD 1.44C
(SHEET 3 OF 4)

CSWP

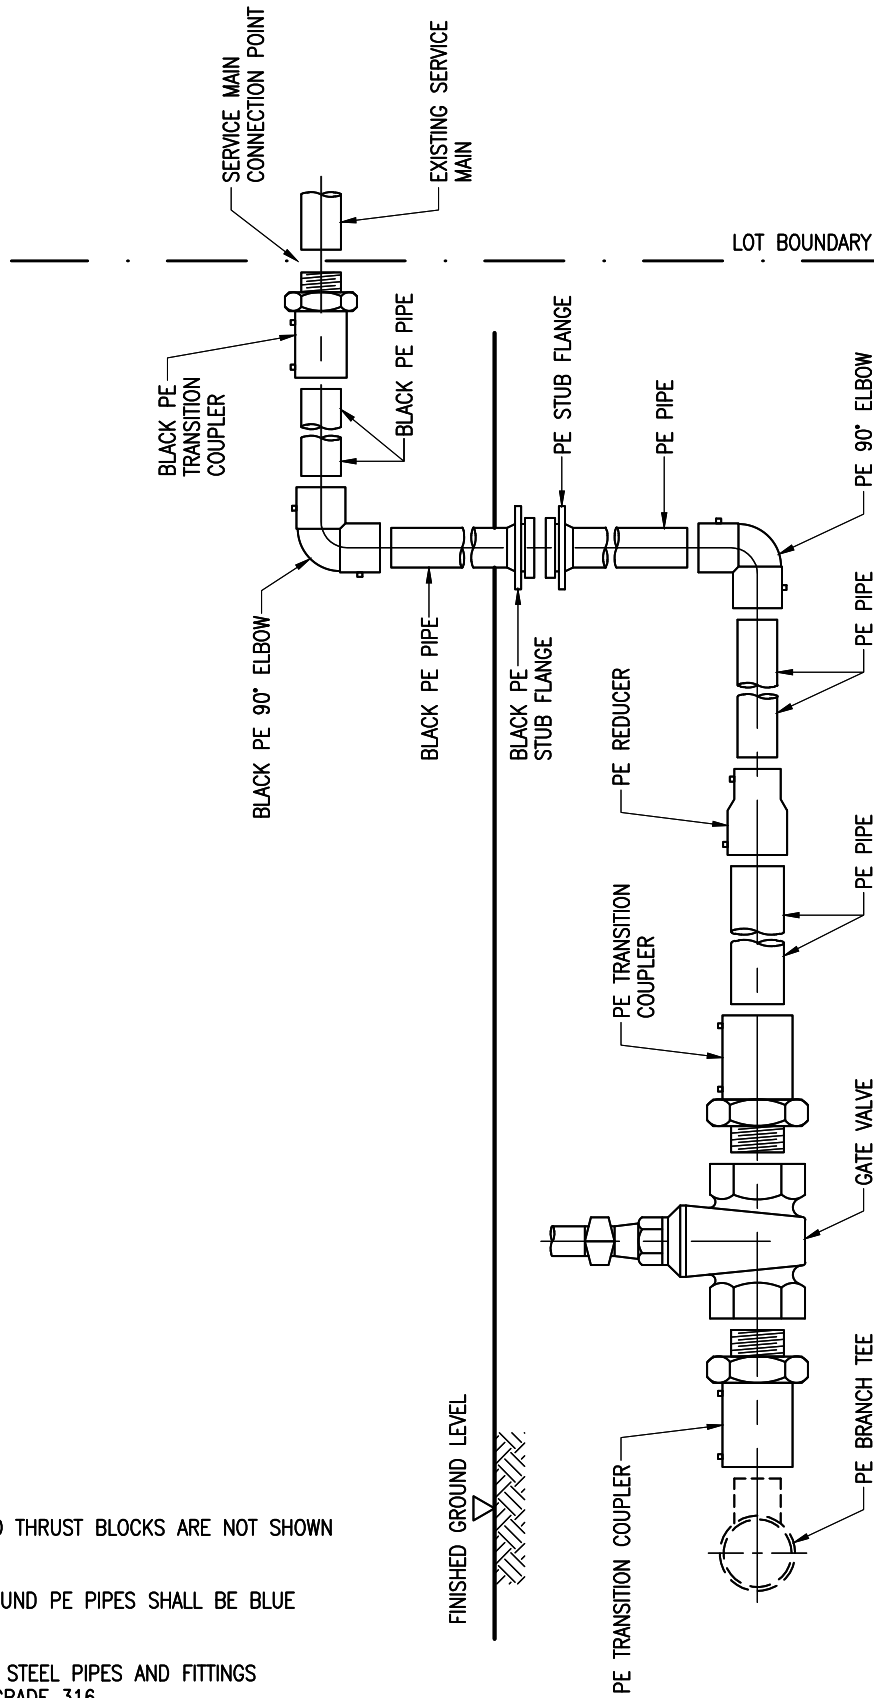

NOTES :

1. CHAMBERS AND THRUST BLOCKS ARE NOT SHOWN FOR CLARITY.
2. ALL UNDERGROUND PE PIPES SHALL BE BLUE IN COLOUR.
3. ALL STAINLESS STEEL PIPES AND FITTINGS SHALL BE IN GRADE 316.

SCHEMATIC SERVICE MAIN CONNECTION ARRANGEMENT FOR SALT WATER MAIN

SCHEMATIC SERVICE MAIN CONNECTION



水務署
Water Supplies Department

APPROVED

C.H. NG
AD/NW

DATE

14/9/07

SCALE

N.T.S.

DRAWING NO.

WSD 1.44C
(SHEET 4 OF 4)

CSWP